



▶ 34.5 kV Cable Replacement

Staff Recommendation for Contract Amendment

December 4, 2025 | BART Board of Directors Meeting





AGENDA

Priority Cable Replacements

Segment 1

Segment 2

Project Timeline

Recommendation to the Board



Priority Cable Replacements




● Substation — Cable
(Not to Scale)


Cable Replacement Segment Lengths

Segment 1: Left & Right Cables 6,000 ft each


Segment 2: Left Cable 12,000 ft

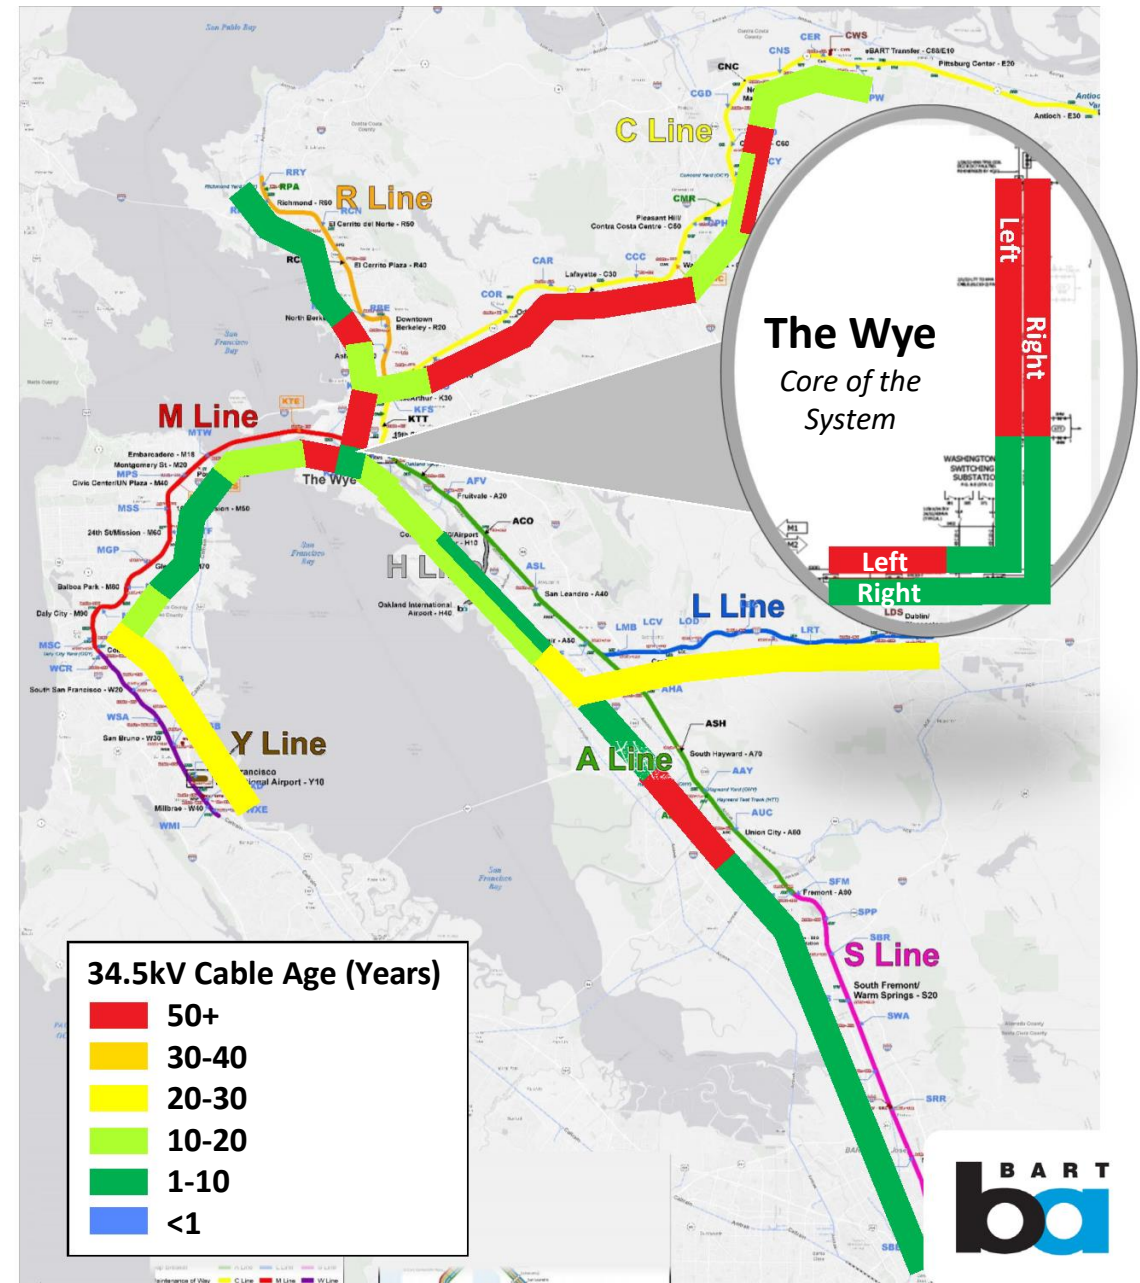



Segment 1

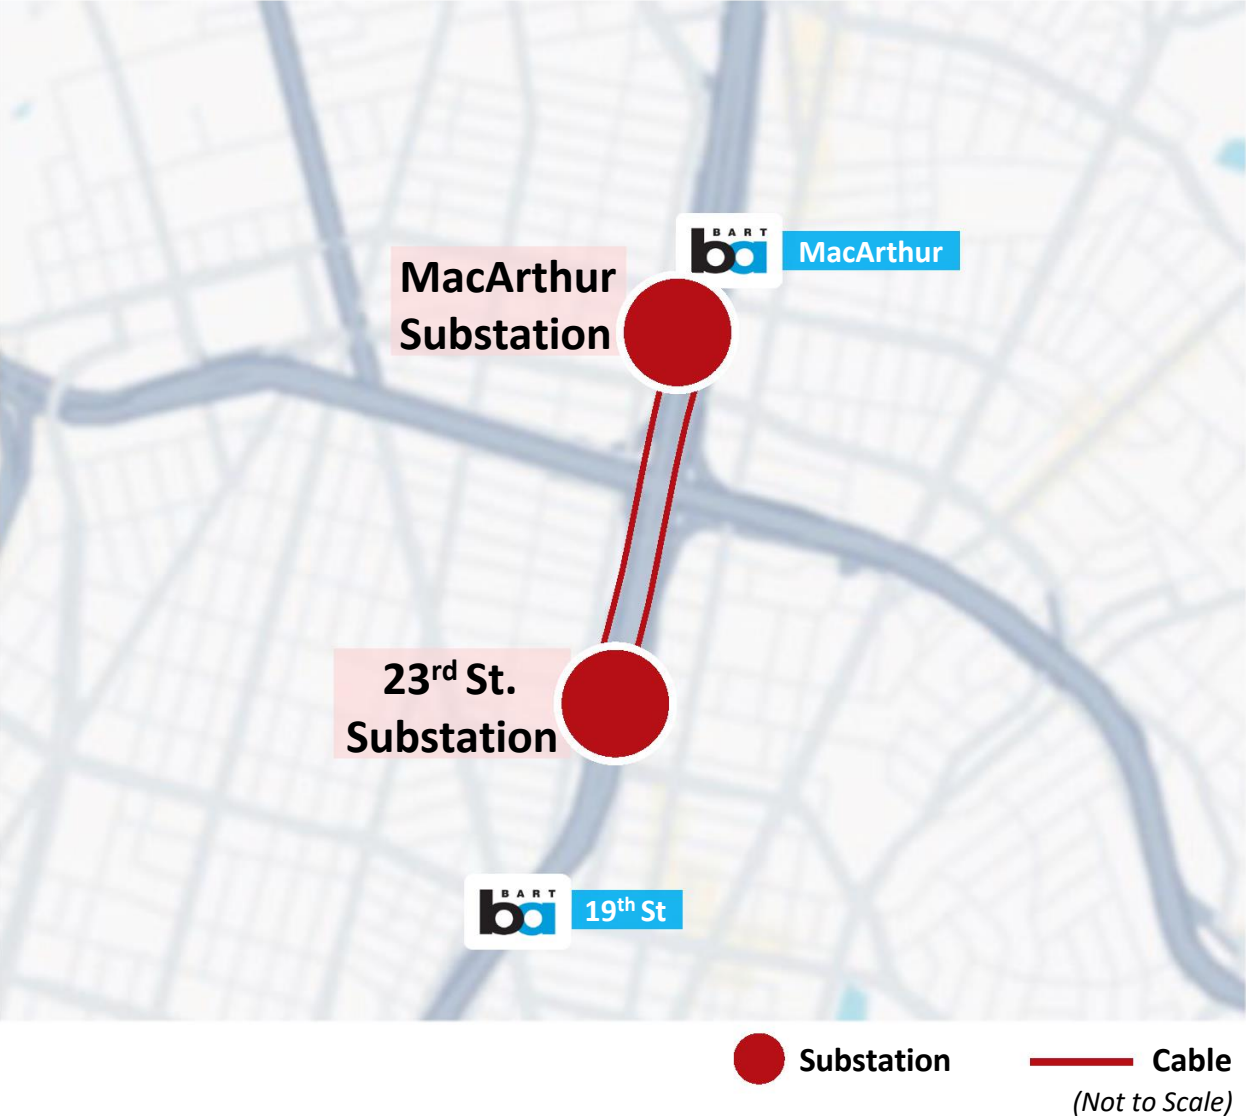

Segment 2

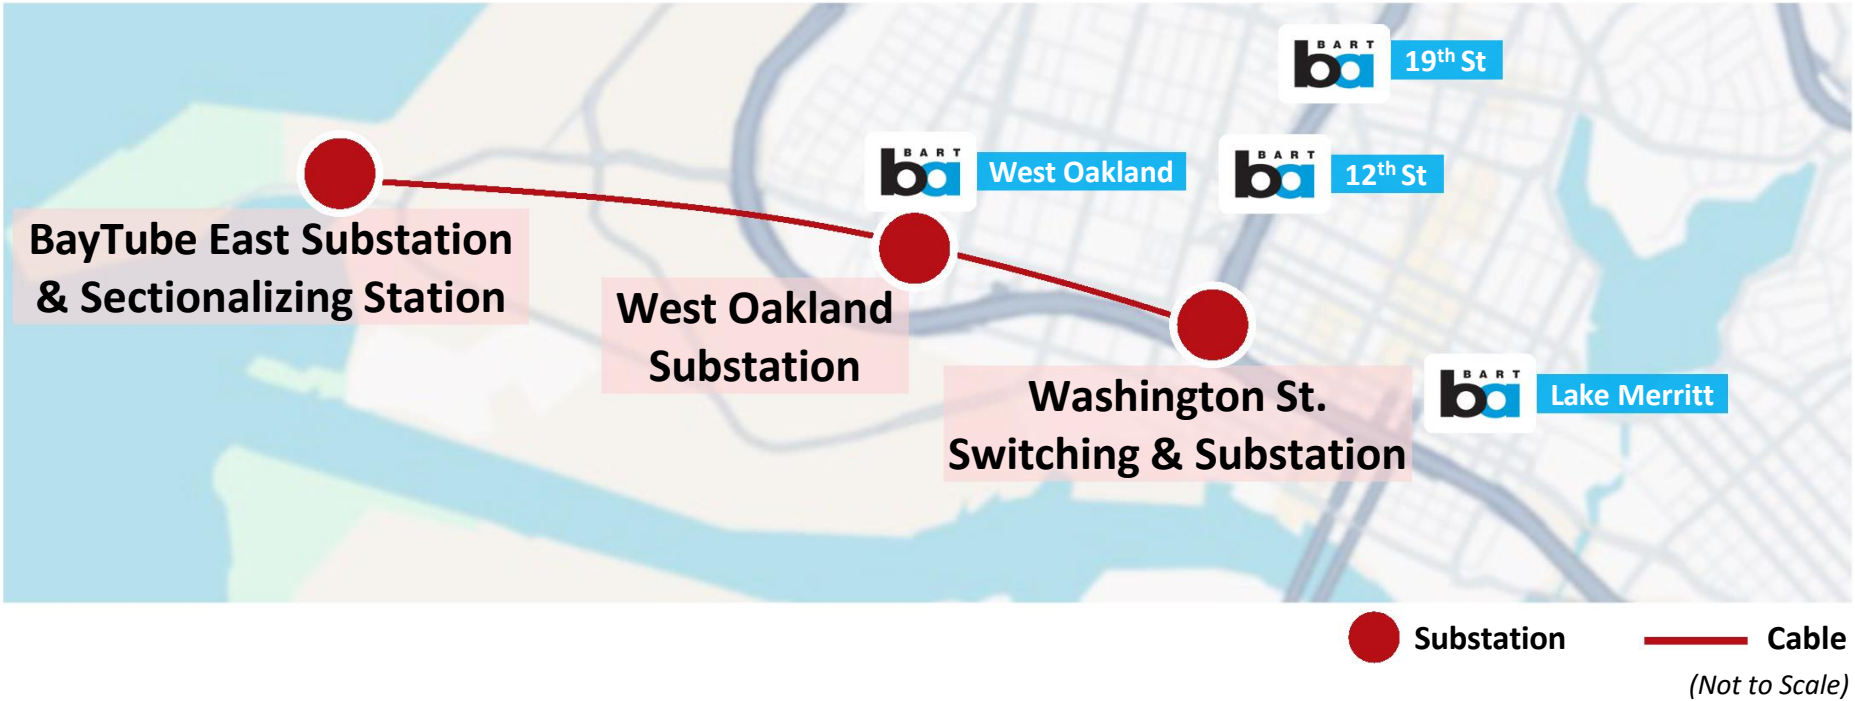

Timeline

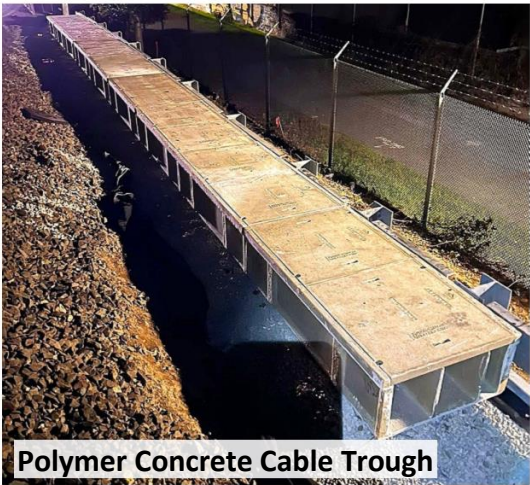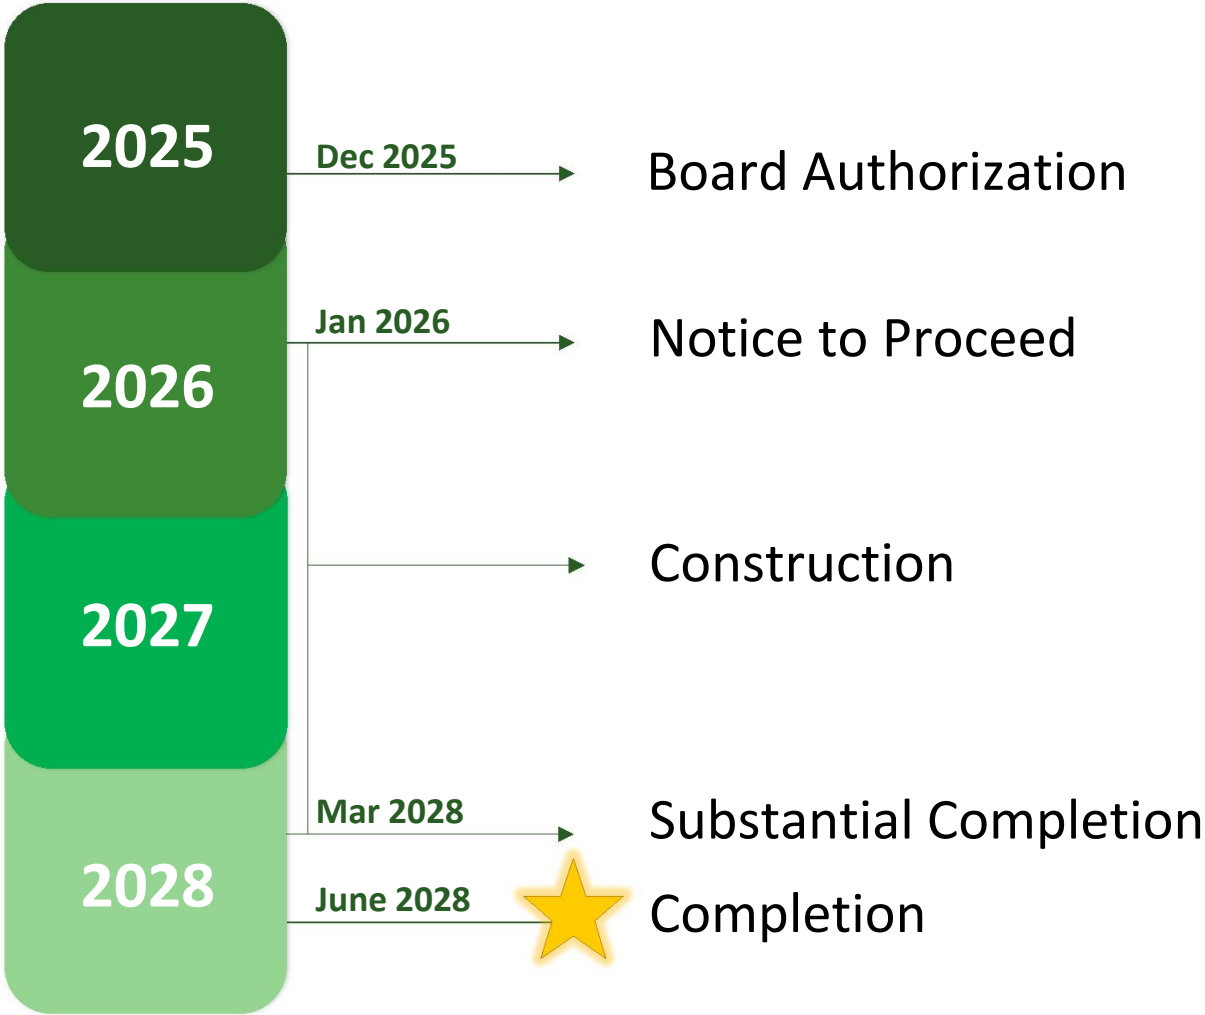

Recommendation to the Board

Authorization for the General Manager to execute a contract amendment to Contract No. 15EJ-180 for the 34.5 kV Cable Replacement and Fiber Optic Cable Installation, A-Line in an amount not-to-exceed \$42,000,000.00 to DMZ Builders.



Thank You

